

Wymiary otworu w stropie

Wymiary gotowego szybu

Otwór na drzwi z ościeżnicą		
Przystanek	Szerokość	Wysokość
A 0	1400	2250
A 2	1400	2250
C 1	1400	2250

D

C

B


A

D


C

B


A

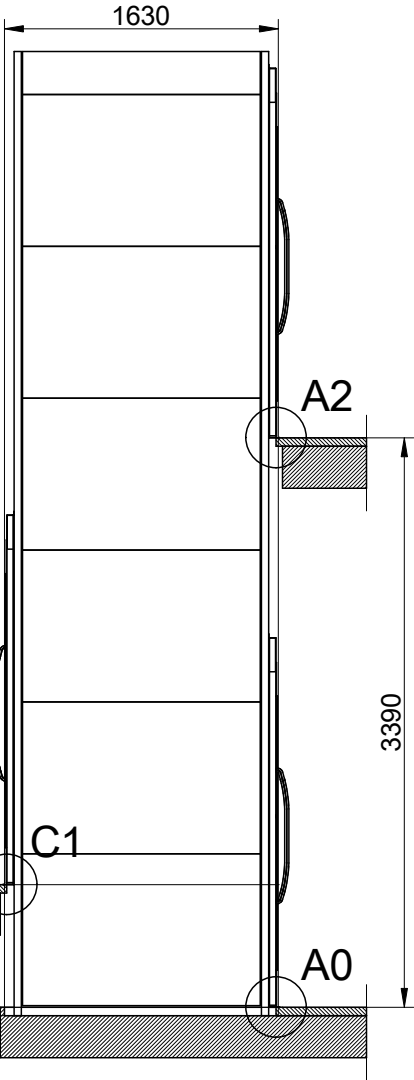


Przekrój E-E

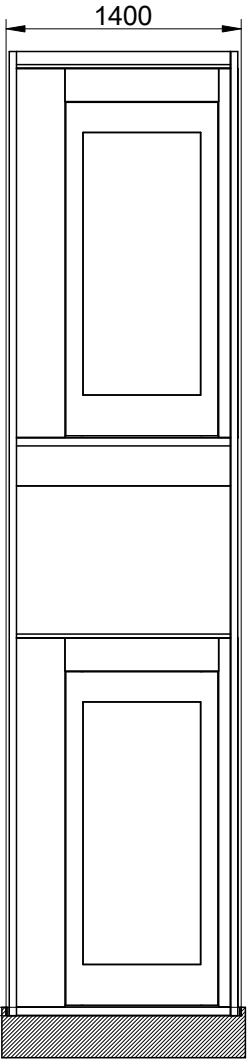

Przekrój G-G

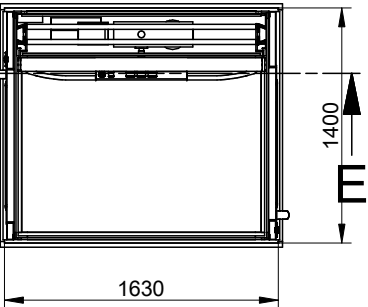


(1:45)

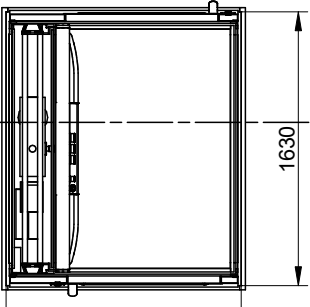


(1:45)

50 mm podszybie, powinno być płaskie, tolerancja +10 mm, - 0mm



A2 (1:5)

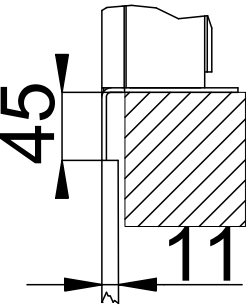

A0 (1:5)

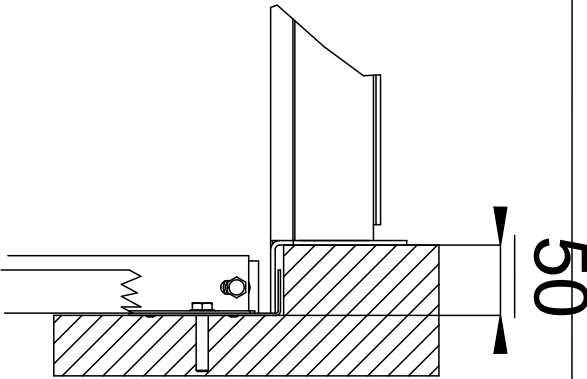

C1 (1:5)

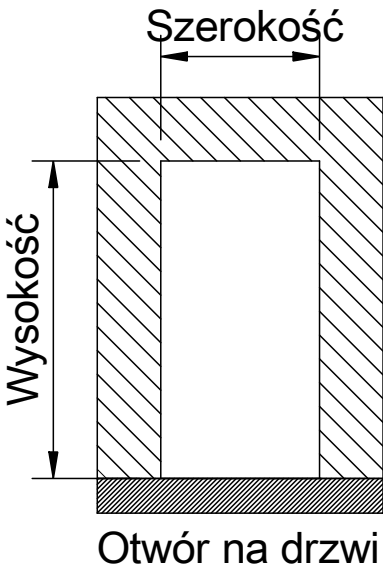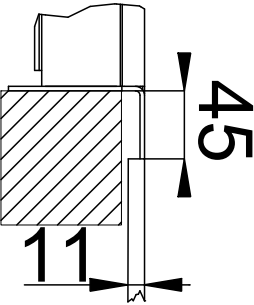

Otwór na drzwi

Incoming power supply is connected at landing:

For wiring and power supply, refer to the unit's wiring diagrams.
Ceiling shaft lighting, is independent from the power cable and pulled back into the trench's upper part. Shaft lighting > 50 lux.

NOTE! An effective emergency telephone is required for approved inspection.
The purchaser is responsible for an active phone line being present prior to the lift installation.

The incoming telephone line is connected to CiLow (TELE). Refer to wiring diagram.

The emergency signal device is powered by the lift's own battery in the event of a power failure.

The lift must be equipped with a two-way communication, either via the standard telephone or via the lift telephone, which automatically calls the alarm control center or the like.

NOTE! A lift featuring a frequency converter cannot be directly connected to a RCD.

NOTE! The platform lift shall be connected to a dedicated power supply conforming with EN 60204-1:2018, terminating at a main switch and fuse or overload with a means to lock it in the 'off' position or disconnected state

Zatwierdzone przez producenta:

European view placement:



EOS ID
L00374858
Oferta
IN59923
Zamówieni

Gen. Tolerances
SS-ISO 27681-1 m

Rysunek schematyczny
A 5000 - 1000*1467
Wymiary otworów
Teatr Żydowski w Warszawie

Data
2022-12-02
15:14

Arkusz
2 of 7

Skala:
A3, 1:50